



Holbrook House, Little Waldingfield,
Sudbury, Suffolk CO10 0TH
Tel: (01787) 247595 Fax: 01787 248420
e-mail: srl@srltsl.com

Contract: C/21850

Page: 1 of 1

Date: 19 March 2012


See SRL report C/21850/R01a for full details

The Laboratory Measurement of Random Incidence Sound Absorption to BS EN ISO 354:2003

Client: Knauf AMF
Test Date: 12/09/2011
Empty Room: Temperature: 18.7 °C Humidity: 78 %RH Pressure: 997 mbar
Room with Sample: Temperature: 19.1 °C Humidity: 75 %RH Pressure: 997 mbar
Sample: Thermatex Aquatec 600x600x19mm
Description:
Mounting Method: E- 200
Sample Area: 10.8 m²
Chamber Volume: 300 m³

Sound Absorption Coefficient

Test 7				
Freq Hz	T1 sec	T2 sec	Absorp Coeff	Practical Absorp Coeff #
50*	5.01	4.00	0.23	
63*	3.74	3.48	0.09	n/a
80*	5.95	4.33	0.28	
100	7.02	4.29	0.41	
125	8.07	4.52	0.44	0.50
160	8.10	3.52	0.72	
200	8.12	3.23	0.84	
250	7.61	3.42	0.72	0.75
315	7.78	3.47	0.72	
400	7.27	3.04	0.86	
500	5.87	2.74	0.87	0.85
630	5.35	2.68	0.83	
800	5.90	2.78	0.85	
1000	6.38	2.82	0.89	0.90
1250	6.19	2.67	0.95	
1600	5.69	2.57	0.95	
2000	5.32	2.40	1.02	1.00
2500	4.71	2.23	1.05	
3150	4.05	2.08	1.04	
4000	3.41	1.89	1.05	1.00
5000	2.81	1.67	1.07	
6300*	2.10	1.42	1.00	
8000*	1.70	1.22	1.00	n/a
10000*	1.26	0.95	1.10	
<i>A_w</i> 0.90				
Class A				
Calculated to EN ISO 11654:1997				
NRC 0.90				
Calculated to ASTM C 423-01				
* Denotes frequencies outside the range covered by BS EN ISO 354:2003				
T1, empty room reverberation time				
T2, room reverberation time with sample				

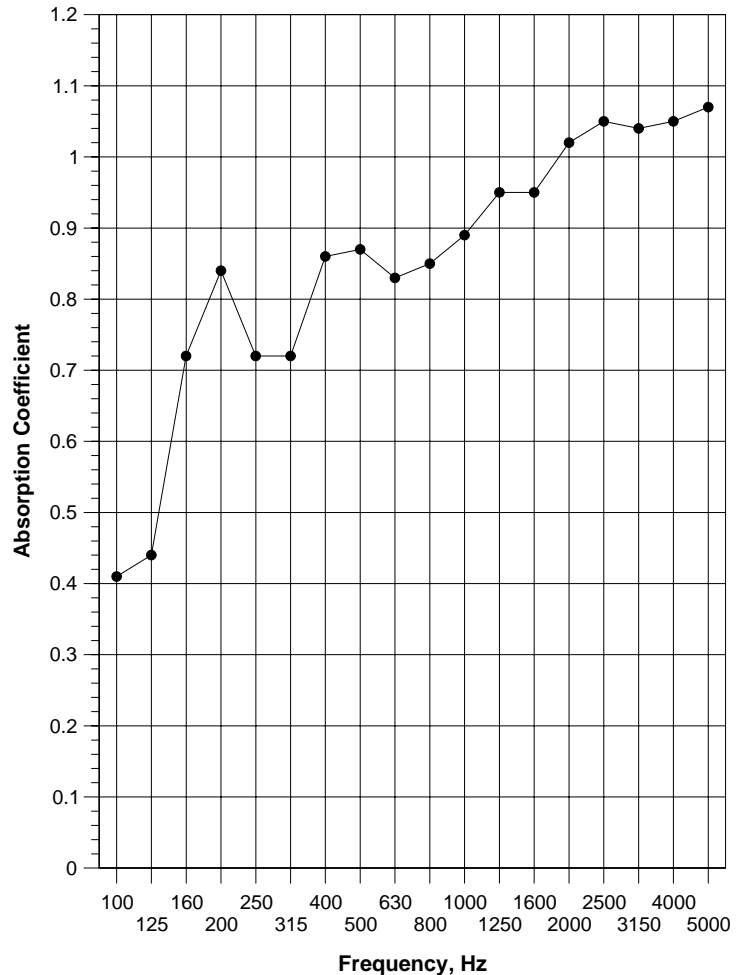

Practical absorption coefficient, BS EN ISO 11654:1997

v3.1