

DATE: 18/6/90


FORGES D'HAIRONVILLE

ESSAIS CSTB JUIN 90: ISOLEMENT IN 210/d

POSTE: D


TOITURE N 2

R dB

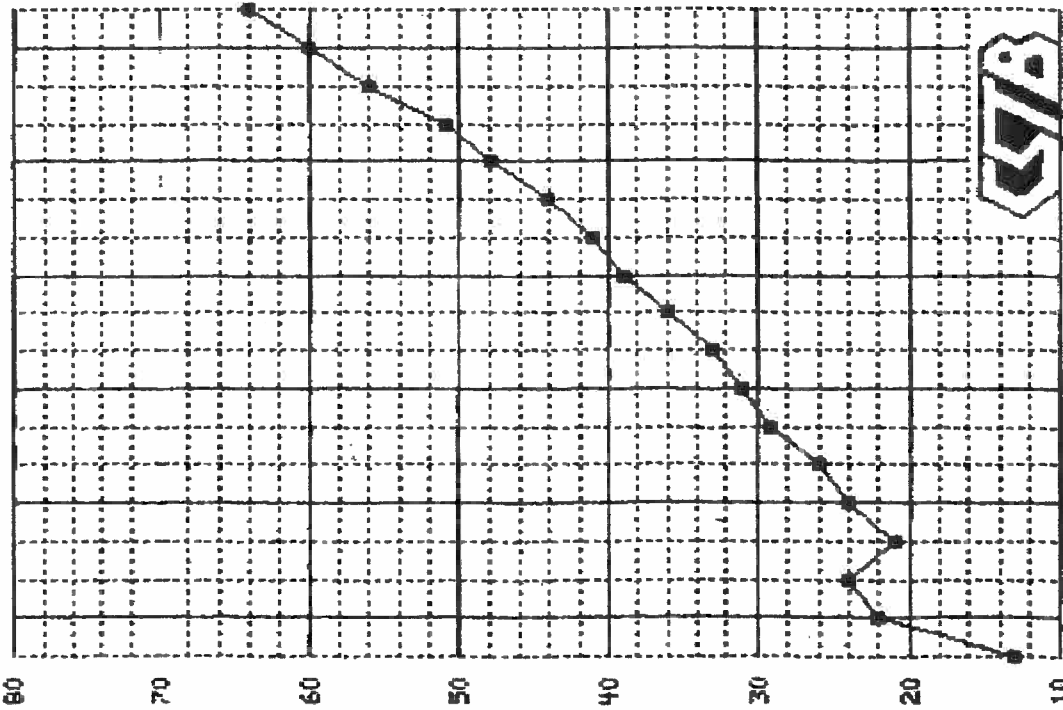

R_{rose} = 34 dB(A)

R_{route} = 29 dB(A)

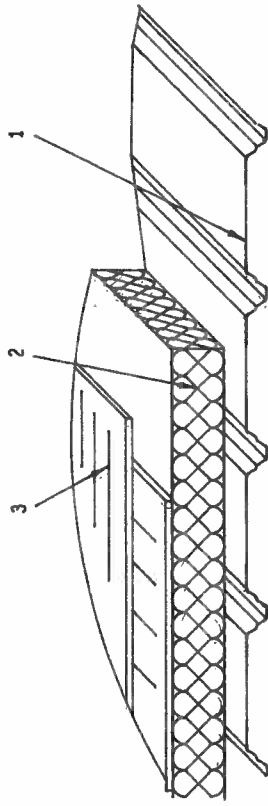

- 1: SUPPORT D'ETANCHEITE (HAIRONVILLE S.A.) 4-258.5-345 ep. 0.75
- 2: PANNEAU RESCO (HAIRONVILLE) ep. 70
- 3: ETANCHEITE MULTICOUCHE: SOPRALENE + ELASTOPHENE (SOPREMA)

